

Please follow these instructions to complete your COVID Rapid Test.

The test results are available 15 – 20 minutes after the test is completed. You may not enter the building without a negative test result.

If you have a positive COVID test result, go immediately to 32470 Haida Dr, Abbotsford, BC V2T 5A6 to get a PCR COVID test.

Please tell the Visitation Host the result from more than 6 feet distance.



Panbio®

COVID-19 Ag RAPID TEST DEVICE (NASAL)

QUICK REFERENCE GUIDE

REF 41FK11/41FK21

DE
Kurzanleitung
(NASAL)
Technischer Support:
Abbott.com/POCT


ES
Guía de referencia rápida
(NASAL)
Asistencia técnica:
Abbott.com/POCT

FR
Guide de référence rapide
(Prélèvement Nasal)
Support Technique ;
Abbott.com/POCT

IT
Guida Rapida di Riferimento
(NASALE)
Supporto Tecnico
Abbott.com/POCT

PT
Guia de referência rápida
(NASAL)
Suporte técnico:
Abbott.com/POCT

RU
Краткое руководство
(назальный тампон)
Техническая поддержка:
Abbott.com/POCT

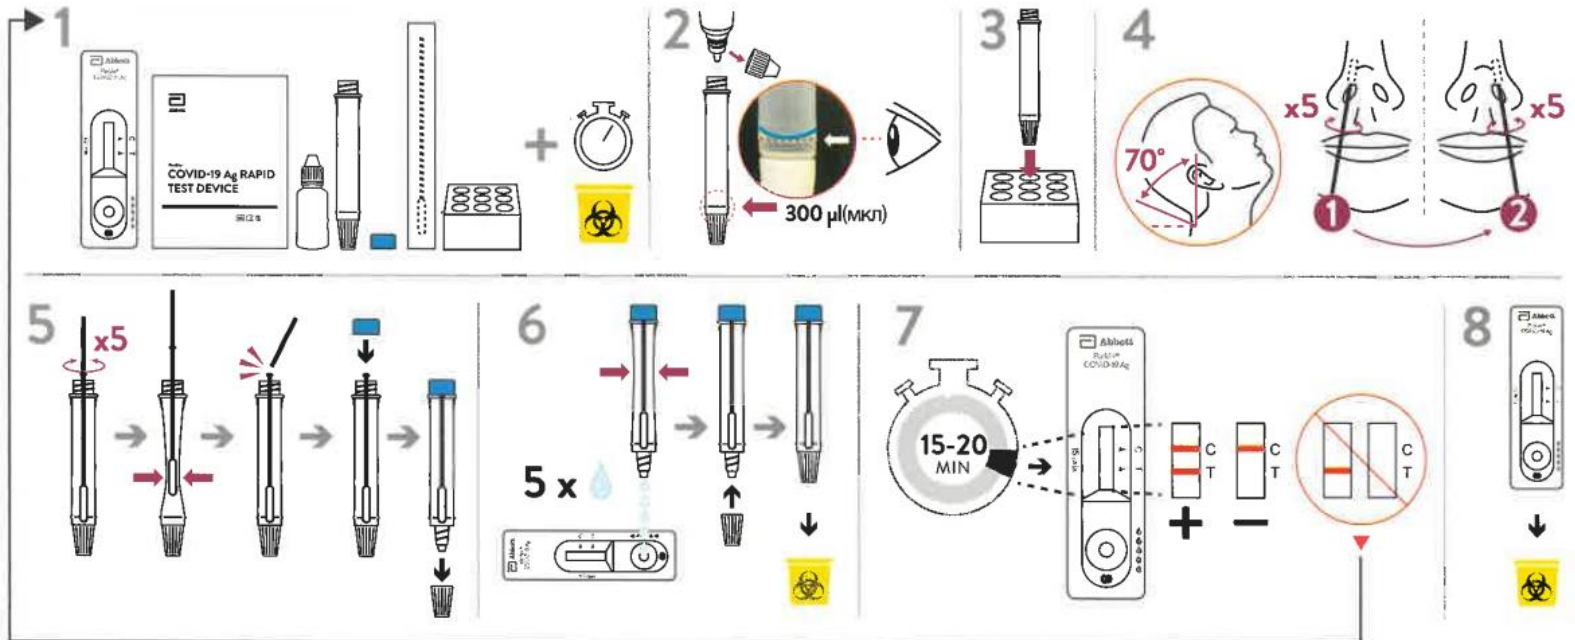

TECHNICAL SUPPORT: ABBOTT.COM/POCT

© 2020 Abbott. All rights reserved. All trademarks referenced are trademarks of either the Abbott group of companies or their respective owners.

41FK11/41FK21-07-QRG-A1